

Culvert End Cap Details and Examples

Culvert end caps shall be a minimum of 8' long* and a minimum of 12" wide. End caps shall have a finished with sides evenly stacked and a flat top. End caps may be constructed with mortar, or may have a dry stack look as long as the construction is neat and constructed to the standards.

*exceptions may be made on the length based on slope or landscaping

FAIRWAY PINES - CULVERT DETAIL

(CMP INSTALLATION MUST BE APPROVED BY ARC FOR QUALIFYING SITUATIONS)


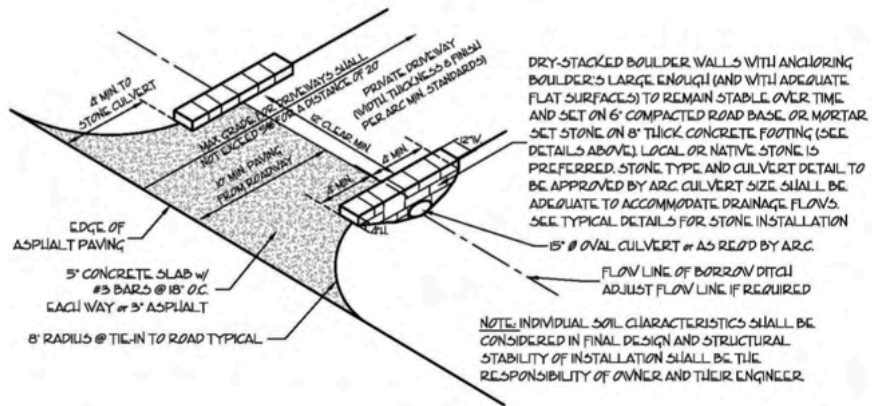


FIGURE 2: ISOMETRIC STONE CULVERT

NOT TO SCALE

Examples of End Caps which meet the Architectural Standards and would be approved

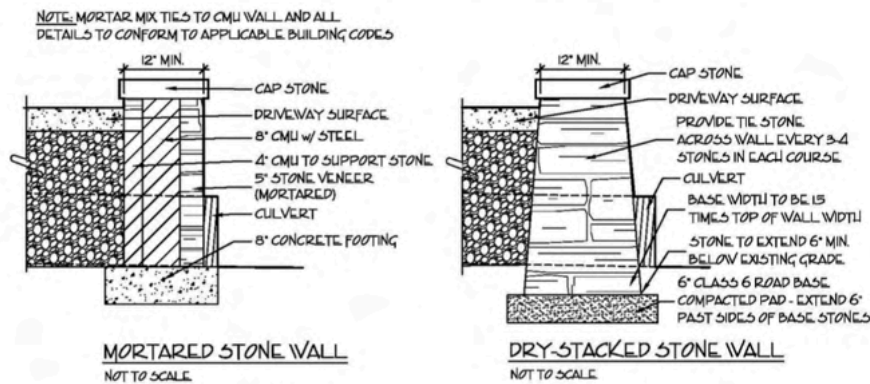

Examples of End Caps which do NOT meet the Architectural Standards and would not be approved



